

CALIBRATION REPORT



Issued By: Laboratory

Certificate Number: 10060

Device Information

Device TAG / ID: TMP_TX
 Type: Temperature Transmitter
 Model: Example 0-150°C 4-20mA
 Serial Number: 09091789
 Location: AREA 996

Procedure Information

Procedure: TMP-TX
 Input Range: 0.00 to 150.00°C
 Output Range: 4.00 to 20.00mA
 Reject Error >: 0.50% of Range

Calibration Information

Calibration Date : 08 May 2011
 Due Date: 06 May 2012 (52wks)
 Temperature: 22.0°C
 Relative Humidity: 50%

Comments:


Calibrator Information

Description	Serial No.	Cert No.	Cal Date	Cal Due
5051+ (DMM mode)	1039C11	0313989	12 Apr 2011	10 Apr 2012
Temperature Standard	Example	Example	12 Apr 2011	09 Apr 2013

Results:

Test Point	Input Temperature	Nominal Output	Actual Output	Allowed Error	% of Range	Pass/Fail
0%	0.00°C	4.00mA	4.03mA	±0.1mA	0.1725%	Pass
20%	30.00°C	7.20mA	7.22mA	±0.1mA	0.1035%	Pass
40%	60.00°C	10.40mA	10.44mA	±0.1mA	0.1800%	Pass
60%	90.00°C	13.60mA	13.62mA	±0.1mA	0.1242%	Pass
80%	120.00°C	16.80mA	16.82mA	±0.1mA	0.1031%	Pass
100%	150.00°C	20.00mA	20.02mA	±0.1mA	0.1205%	Pass

End Of Results

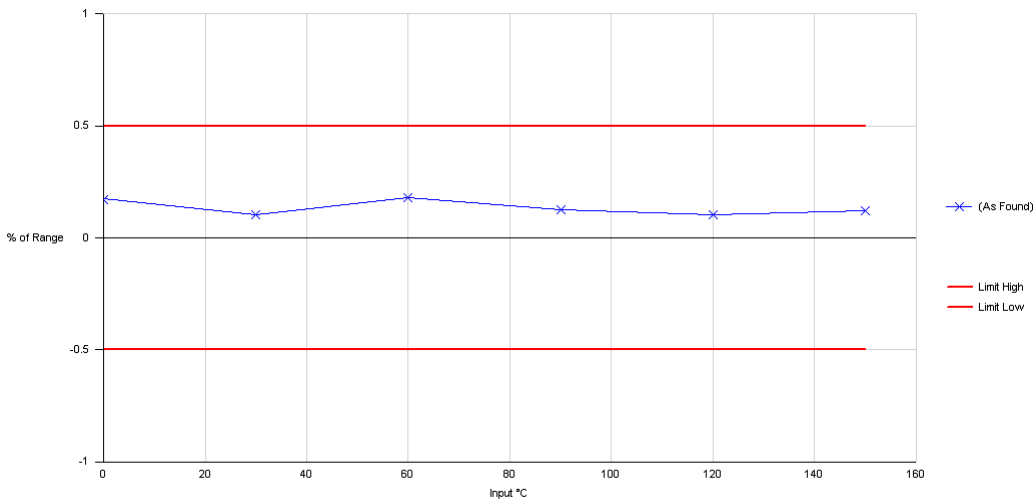

Comments:

Calibrated by: Op 1

Approved By: Sig 3

Signed: _____

Approved Date: 16-May-2011